

APPROVED
Omissions & Errors on Plans
shall not be valid and all codes,


and Laws must be complied with:

Insp WKL Permit # 110929

SMOKE DETECTORS (BATTERY OPERATED)
REQUIRED IN ALL SLEEPING ROOMS
WHEN THE VALUE OF WORK EXCEEDS
\$1000 FOR ADDITIONS, ALTERATIONS OR
REPAIRS

APPROVAL SUBJECT TO FIELD INSPECTION
FOR COMPLIANCE WITH APPLICABLE CODES
AND MANUFACTURER'S SPECIFICATIONS.

APPLICABLE CODES
1994 UBC 1994 UPC
1994 UMC 1993 NEC

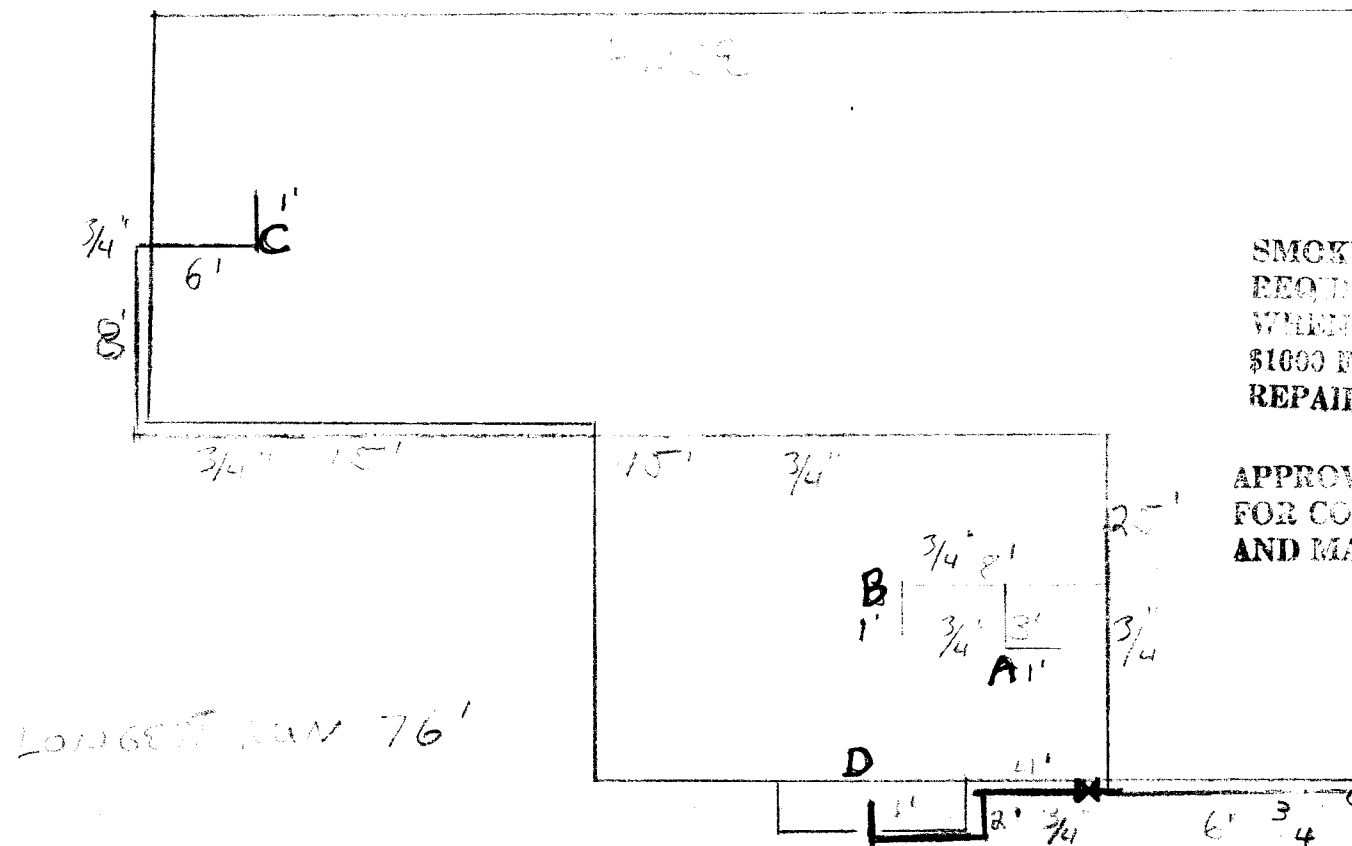

A FURNACE	85.000
B WATER HEATER	38.000
C WALL FURNACE	25.000
L ROOM HEATER	30.000

TOTAL BTU'S 178,000 BTU'S

NEW LINE

OLD LINE

234

(E)

240 GAL LR